


Building address: Lidoņu iela 27 k-2
Building type: Non-residential
Year of construction: 1960-1990
Date: 5-06-2024
Assessor's name: Edgars Augustiņš



Total SRI Score: 14.7 %
SRI Class: G


IMPACT SCORES

Energy Efficiency: 38.2%
Energy Flexibility and Storage: 8.05%
Comfort: 25%
Convenience: 20.83%
Health, well-being and accessibility: 21.43%
Maintenance and fault prediction: 0%
Information to occupants: 0%

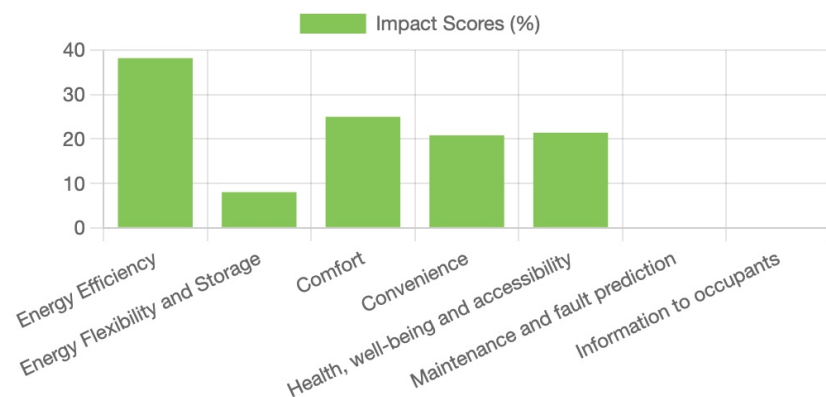

DOMAIN SCORES

Heating: 21.21%
Domestic hot water: 24.1%
Cooling: 0%
Ventilation: 0%
Lighting: 0%
Dynamic building envelope: 0%
Electricity: 0%
Electric vehicle charging: 0%
Monitoring and control: 0%

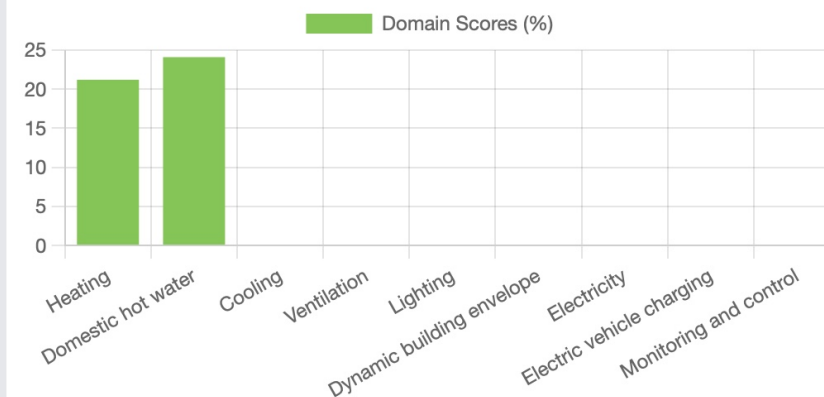

DETAILED SCORES

Heating:
Domestic hot water:
Cooling:
Ventilation:
Lighting:
Dynamic building envelope:
Electricity:
Electric vehicle charging:
Monitoring and control:

Energy Efficiency:	Energy Flexibility and Storage:	Comfort:	Convenience:	Health, well-being and accessibility:	Maintenance and fault prediction:	Information to occupants:
50 %	0 %	50 %	36.4 %	60 %	0 %	0 %
33.3 %	33.3 %	0 %	33.3 %	0 %	0 %	0 %
0 %	0 %	0 %	0 %	0 %	0 %	0 %
0 %	0 %	0 %	0 %	0 %	0 %	0 %
0 %	0 %	0 %	0 %	0 %	0 %	0 %
0 %	0 %	0 %	0 %	0 %	0 %	0 %
0 %	0 %	0 %	0 %	0 %	0 %	0 %
0 %	0 %	0 %	0 %	0 %	0 %	0 %
0 %	0 %	0 %	0 %	0 %	0 %	0 %

AGGREGATED SCORES

1 - Building: 19.1%
2 - User: 16.82%
3 - Grid: 8.05%